# PROPOSED SEWAGE SYSTEM
FOR
# NORMAN BAILEY
LAFAYETTE SEABROOK

SCALE 1"=20' SEPT 1969
PARKER SURVEY ASSOC. INC.
SEABROOK, N.H.

DISIGN DATA
PERC. RATE = 3 MIN/INCH = 45 S.F./100 GAL/DAY
20 EMPLOYES @ 35 GAL/DAY = 700 GAL/DAY
3 BEDR'M = 100 = 300 GAL/DAY 700 + 300 = 1000 GAL/DAY
1000 GAL/DAY x 45 SF/100 GAL/DAY = 450 SF FIELD
TANK
1000 GAL/DAY x 150 % = 1500 TANK

NOTE ELV. ASSUMED BASE

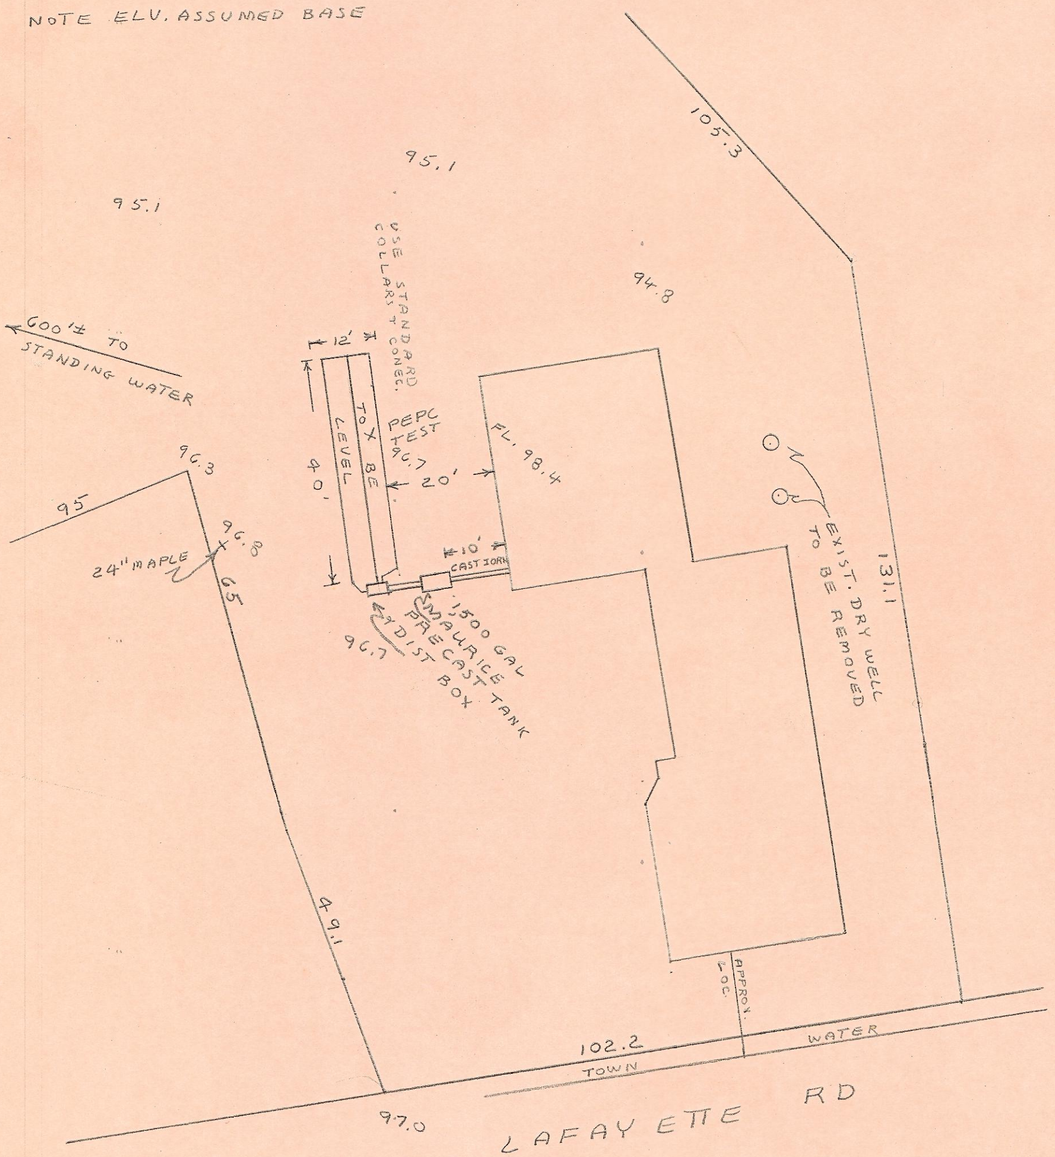


## PARTIAL SECTION OF LEACHING BED

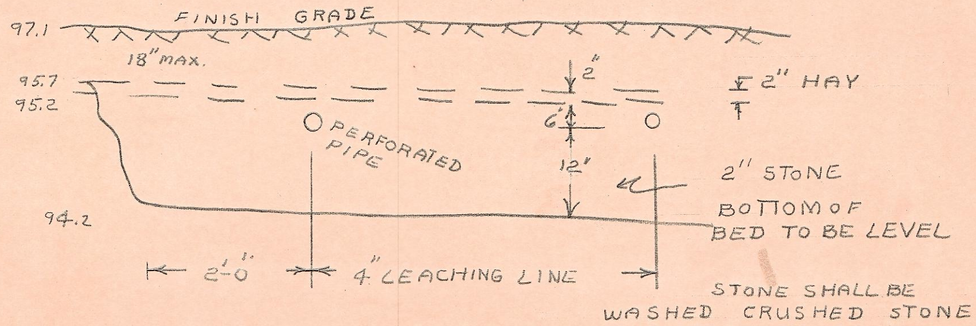


## TEST PIT & SOIL LOG

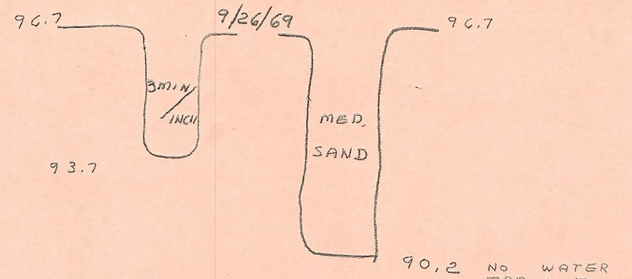


LEDGE OR OTHER IMPERMEABLE SUB-STRATUM 10' OR MORE

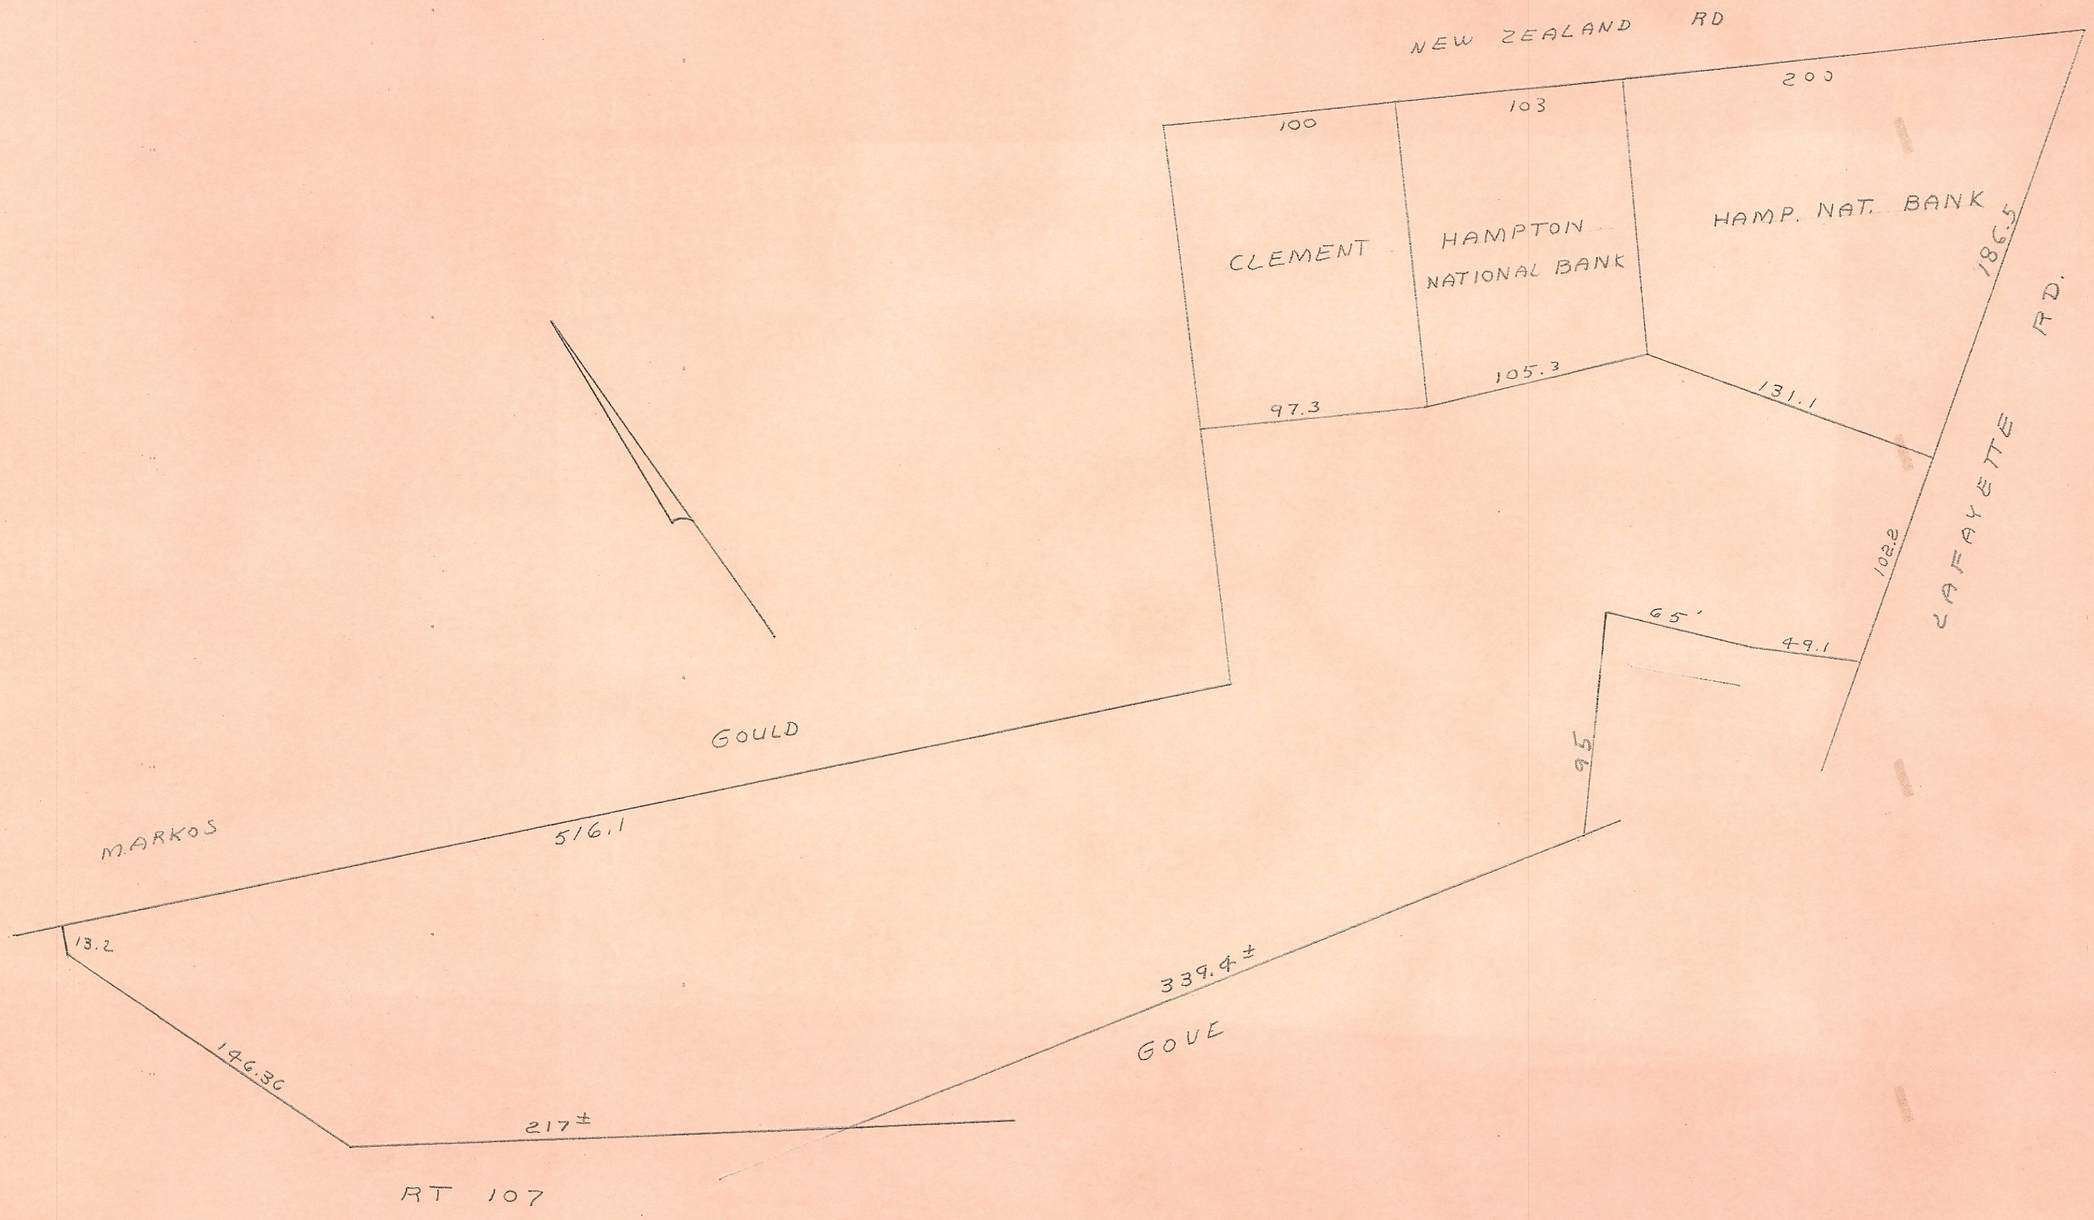


NORMAN E. BAILEY LAND
LAFAYETTE ROAD
SEABROOK NH
PARCIAL COPY FROM
PLAN BY
WALTER F. O'NEILL